

NORMAL DEPTH TO THE TOP OF THE CABLE WHEN LAID

	services	lv	hv	ehv
FOOTPATH	0.45m	0.45m	0.60m	0.80m
ROAD CROSSING	0.60m	0.60m	0.75m	0.90m
AGRICULTURAL	0.60m	0.60m	0.75m	0.90m

lv./services - up to 1000V.
h.v. - over 1000V to 11,000V.
e.h.v. - 22,000V to 132,000V.

WARNING

There may have been subsequent alterations to the surface levels. Trial holes must be taken to determine positions and depth of cables. BS (C) 47 Booklet from the Health and Safety Executive - Avoiding Danger from Buried Cables - should be consulted before commencing excavation work. (available from the HSE)

WHEN WORKING IN THE VICINITY OF OVERHEAD LINES THE HEALTH AND SAFETY GUIDANCE NOTE SHOULD BE CONSULTED. (AVAILABLE FROM THE HSE)

BASED UPON THE ORIGINALE SURVEY MAP WITH THE SANCTION OF THE CONTROLLER OF L.A. STATUTORY OFFICE. OTHER CORRECTIVE RECORDS

This copy has been made by or with the authority of Southern Electric Power Distribution plc pursuant to section 47 of the Copyright, Design and Patents Act 1988 (the Act). Subject to the Act providing a relevant exception to copyright, this copy must not be copied without the prior permission of the copyright owner.

Southern Electric Power Distribution Southampton, SO31 4HP
Registered Office: 1, Tenney Place
43 Factory Road, Basing, Hants RG23 3BH


UNCONTROLLED COPY
Subject to Revision Master held at

Scottish & Southern
Electricity Networks

H.V. MAINS RECORD

If you are unsure & need to seek advice before commencing excavations please contact
NEW FOREST
023-9081-7300

GRIDREF: SU47400739
SCALE: 1:1250
DATE: 26/07/2018
MSS330835

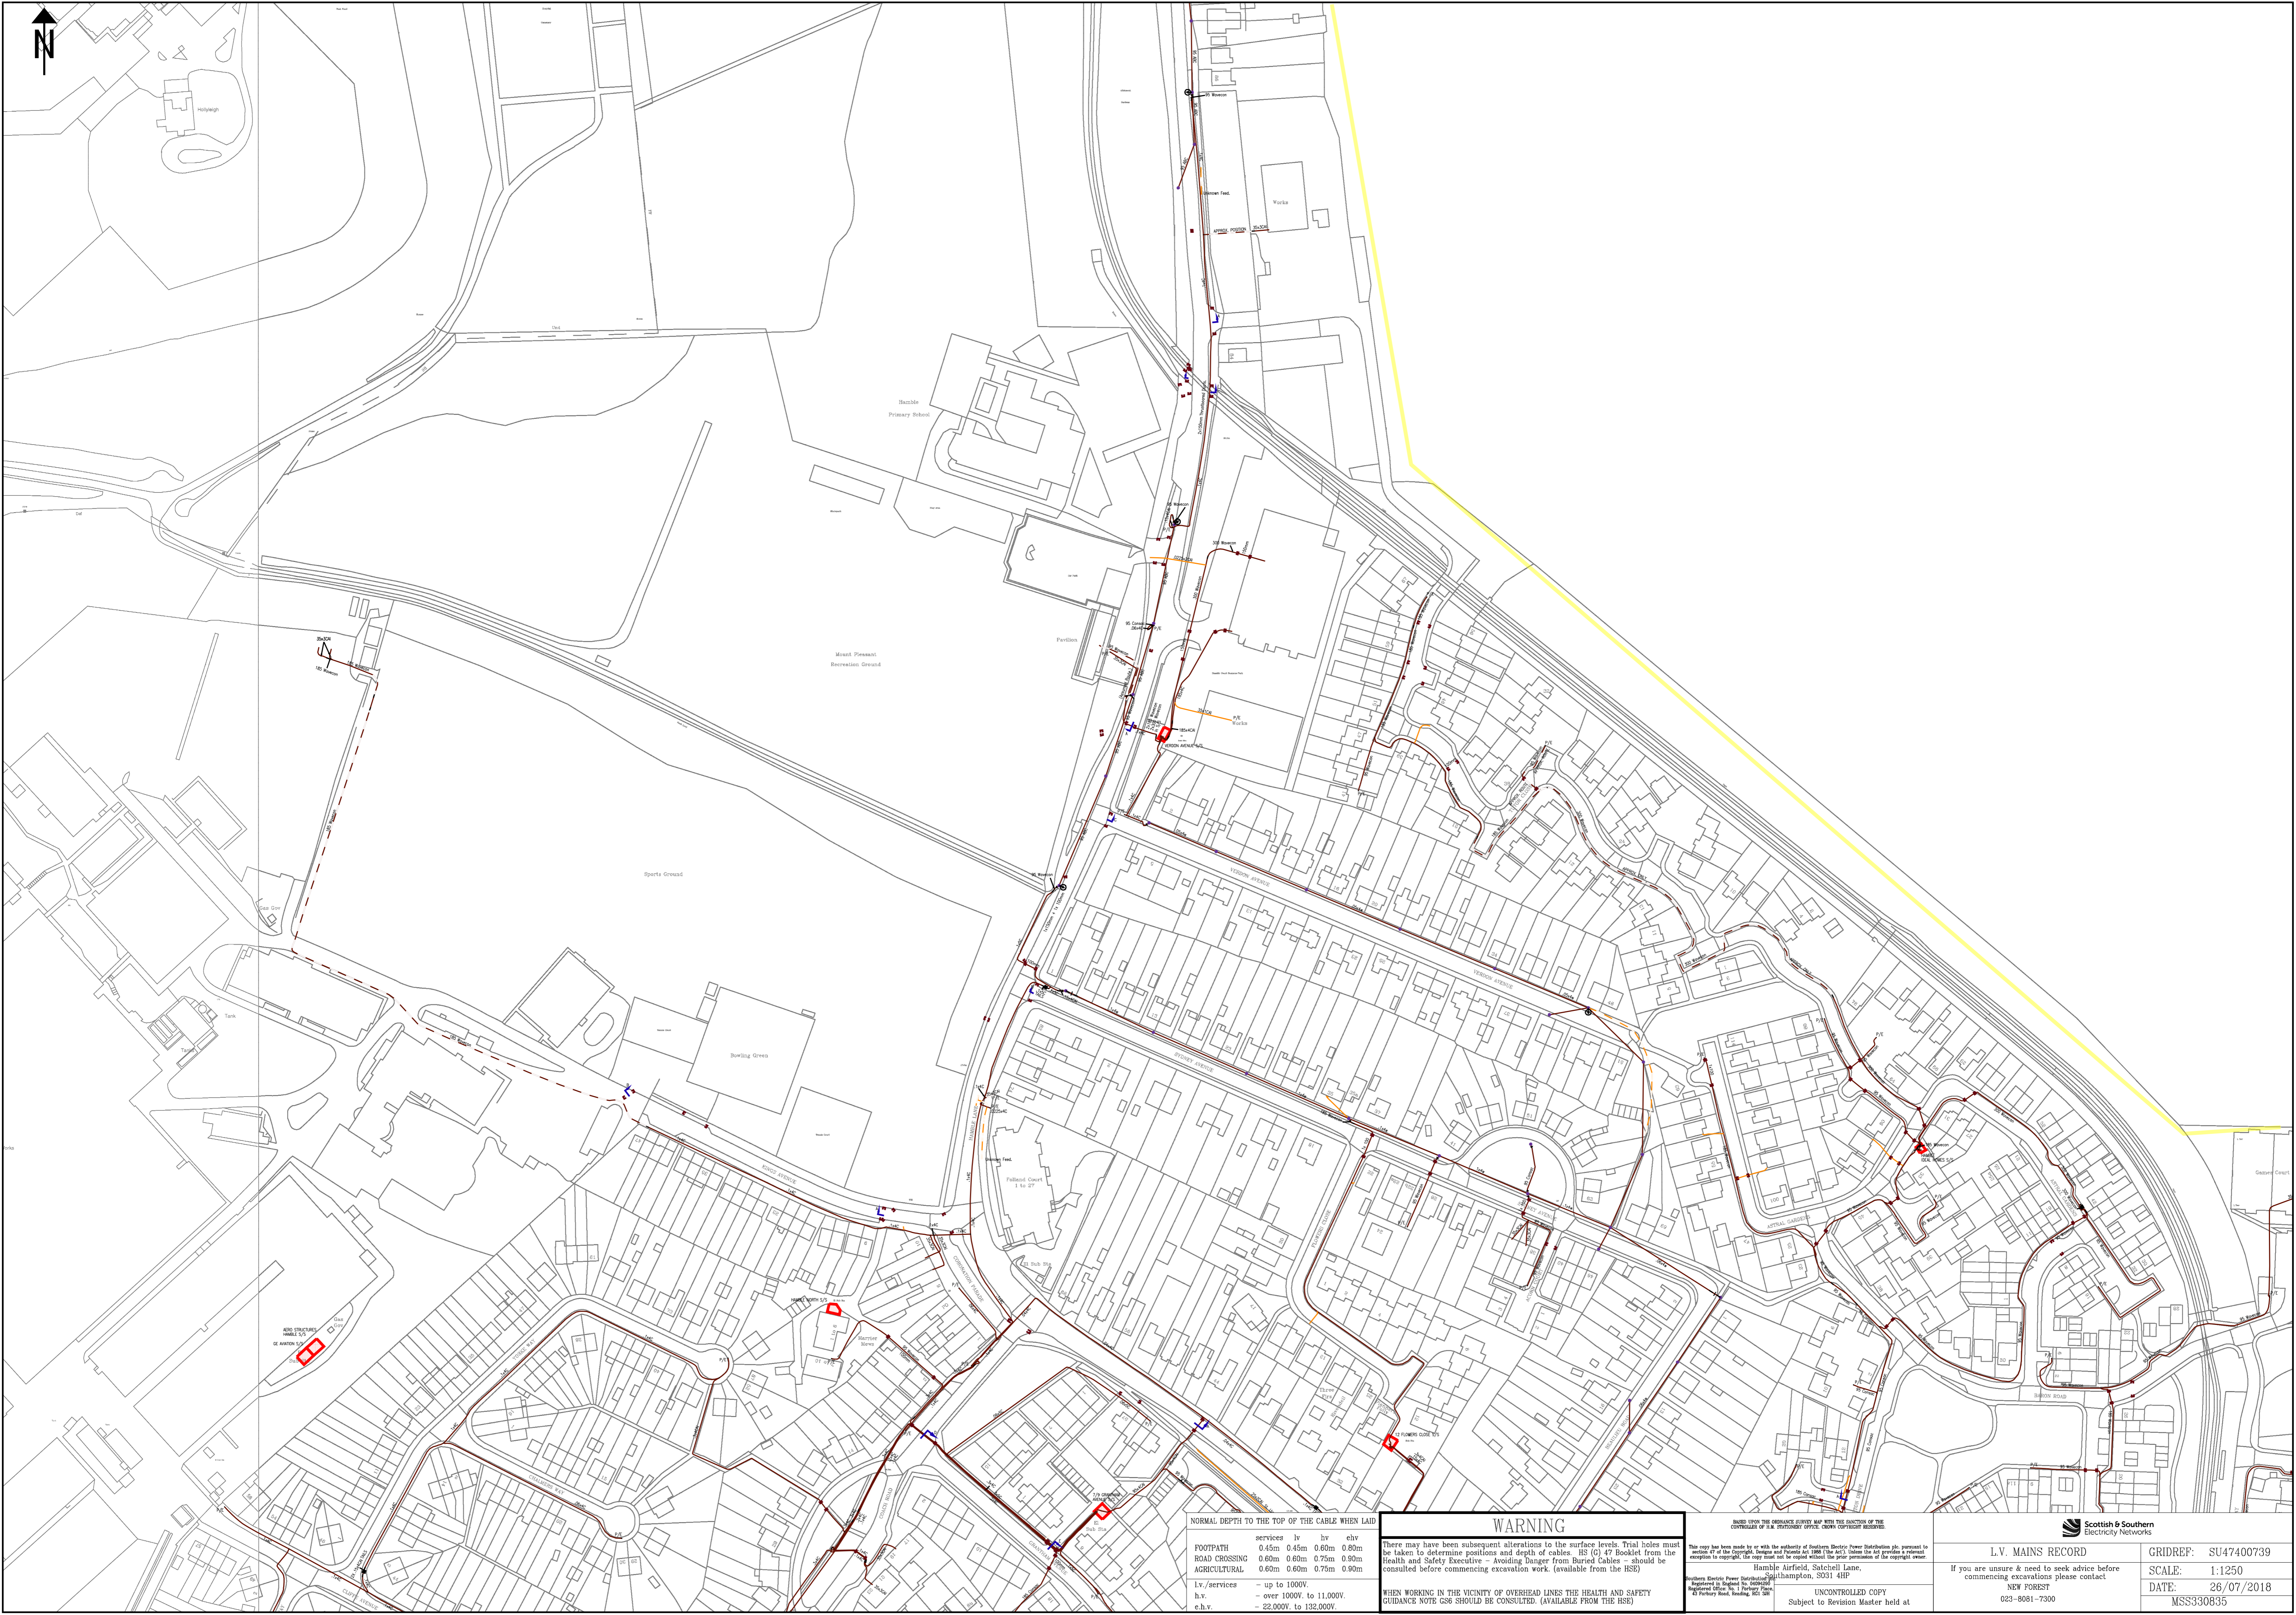

NORMAL DEPTH TO THE TOP OF THE CABLE WHEN LAID

	services lv	lv	ehv
FOOTPATH	0.45m	0.45m	0.60m 0.80m
ROAD CROSSING	0.60m	0.60m	0.75m 0.90m
AGRICULTURAL	0.60m	0.60m	0.75m 0.90m

l.v./services
 - up to 1000V.
 h.v.
 - over 1000V to 11,000V.
 e.h.v.
 - 22,000V to 132,000V.

WARNING

There may have been subsequent alterations to the surface levels. Trial holes must be taken to determine positions and depth of cables. BS (C) 47 Booklet from the Health and Safety Executive - Avoiding Danger from Buried Cables - should be consulted before commencing excavation work. (available from the HSE)

WHEN WORKING IN THE VICINITY OF OVERHEAD LINES THE HEALTH AND SAFETY GUIDANCE NOTE G58 SHOULD BE CONSULTED. (AVAILABLE FROM THE HSE)

BASED UPON THE ORIGINALLY SURVEYED MAP WITH THE ADDITION OF THE CONTINUOUS OR L.V. MAINS RECORD.

This copy has been made by or with the authority of Southern Electric Power Distribution plc pursuant to section 47 of the Copyright, Design and Patents Act 1988 (the Act). Subject to the Act, no liability is accepted for any errors or omissions, or for any loss or damage, howsoever caused, arising from the use of this copy.

Humble Airfield, Salsfield Lane,
 Southampton, SO9 4HP

Southern Electric Power Distribution
 Registered in England to 0202000
 43 Factory Road, Reading, RG1 3BH

UNCONTROLLED COPY
 Subject to Revision Master held at

Scottish & Southern
 Electricity Networks

L.V. MAINS RECORD

If you are unsure & need to seek advice before commencing excavations please contact
 NEW FOREST
 023-9081-7300

GRIDREF: SU47400739
 SCALE: 1:1250
 DATE: 26/07/2018
 MSS330835